

Art. nr	Aqualux 1000 Teknik	Aqualux 1000 UB	Aqualux 750 Teknik	Aqualux 750 UB	Aqualux 750 CU	Aqualux 500 Teknik	Aqualux 500 UB	Ack-tank 500 CU	Ack-tank 500 UB
Volym Fassungsvermögen Volume	2127 802 / 160	2128 962 / -	2125 574 / 160	2121 734 / -	2120 734 / 120	2126 312 / 160	2019 472 / -	2130 361 / 120	2131 481 / -
mantel/vvb Mantel/WWS jacket/water heater									liter
Varmhållningsförlust Wärmeverlust im Bereitschaftszustand Standby heat loss	0,220	0,195	0,194	0,166	0,158	0,164	0,133	0,143	0,135
kW									
Energiklass Energieeffizienzklasse Energy class	-	-	-	-	-	E	D	D	D


 **Uttjänt produkt ska materialåtervinnas!**
Isoleringen sorteras som isolering, pannkärn och klädselplåt
som metallskrot samt el- och elektronik som elektronik-
skrot.

Ausgediente Produkte sind dem Recycling zuzuführen.
Isoliermaterial als Isolierung, Metallteile zum Schrott und
Strom-/ Elektronikteile zum Elektroschrott.elektronikskrot.
After dismantling, boiler materials must be recycled.
Insulation is licked out and sorted as insulation. The boiler
body and cladding sheets are sorted as steel scrap. Elec-
trical and electronic components are sorted as electronic
scrap.

 **Arbeta aldrig på en spännings- eller trycksatt produkt!**
Se "Säkerhet och hantering" i produktens installations och
skötselanvisning.

Vor Arbeiten am Gerät ist der Netzstecker zu ziehen und der
Druck abzulassen. Siehe hierzu die Hinweise der Installa-
tions- und Betriebsanleitung.

Disconnect the boiler from the power supply and lock the
switches before service/repairs.
Never carry out maintenance work/service on pressure-
bearing parts when they are pressurised.

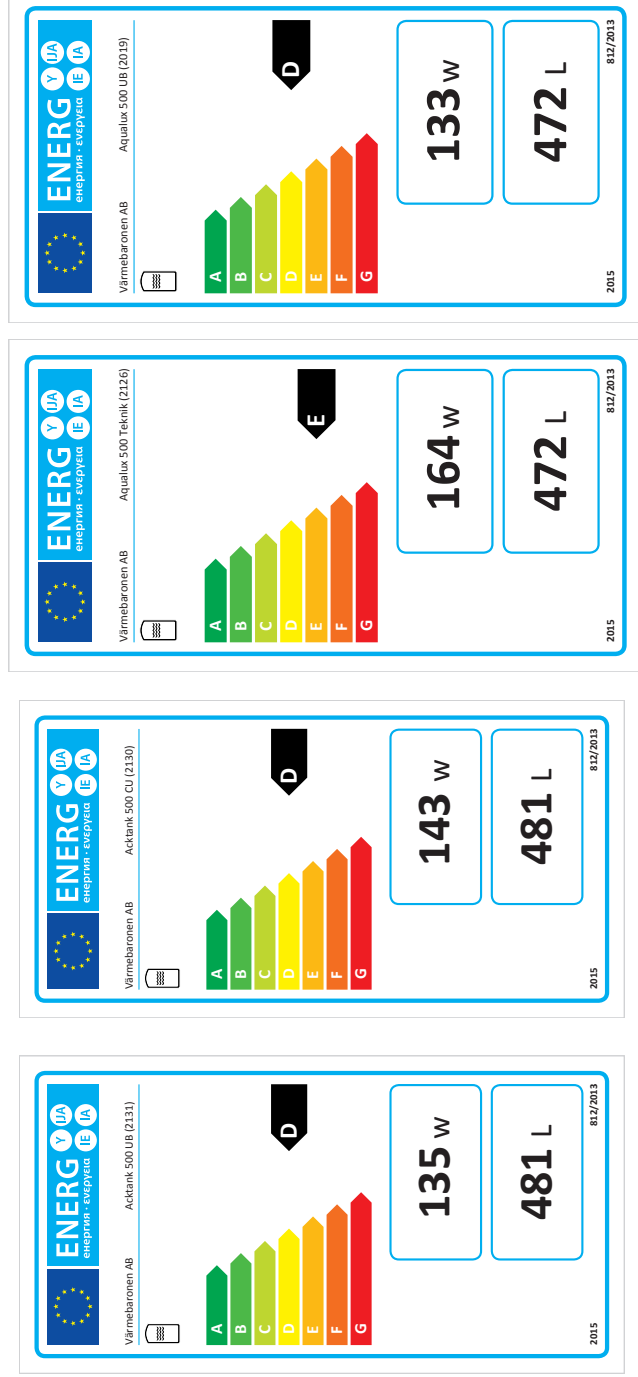



ENERG
енергия · ενεργεια



Värmebaronen AB

Aqualux 500 Teknik (2126)



164 _W

472 _L



ENERG
енергия · ενεργεια



Värmebaronen AB

Aqualux 500 UB (2019)



133_w

472_L



ENERG
енергия · ενεργεια



Värmebaronen AB

Acktank 500 CU (2130)



143 W

481 L



ENERG
енергия · ενεργεια



Värmebaronen AB

Acktank 500 UB (2131)



135 W

481 L