



REFRIGERATION AND
AIR CONDITIONING

Instructions


AK-XM 102A





080R9213




RI8HG502



080Z0008

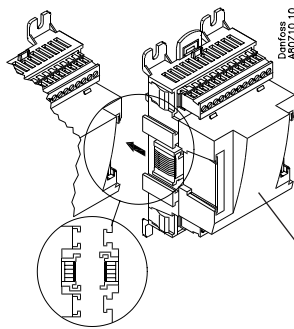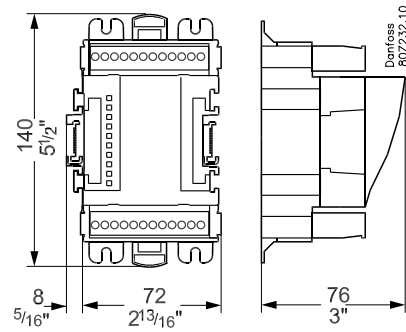

AK-XM 102A

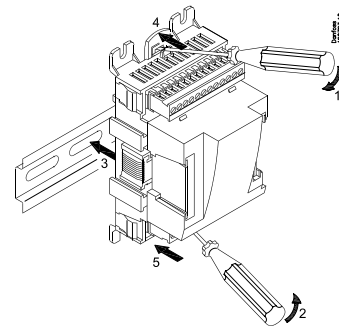

-20°C < t_{amb} < 55°C
-0°F < t_{amb} < 130°F
0 - 95% RH, non condensing
IP10 / VBG4
UL: E357029



Warning


Ensure power is
disconnected before
adding or removing
Modules

DI x 8




24 V



On/Off:
On: DI > 10 V a.c. / d.c.
Off: DI < 2 V a.c. / d.c.

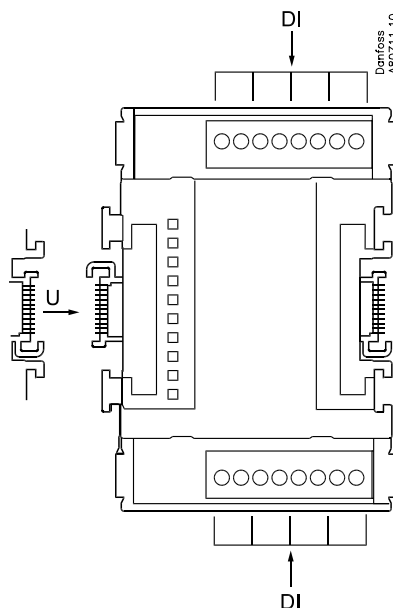

Point

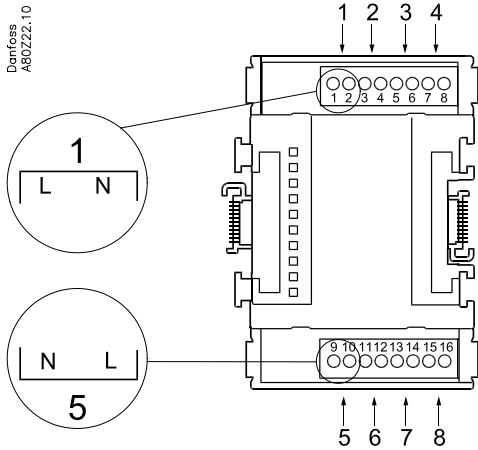

	Signal	Active at
DI	Ext.Main Switch	Closed (voltage on)
	Day/ Night	/
	Comp. Safety 1	Open (voltage off)
	Comp. Safety 2	

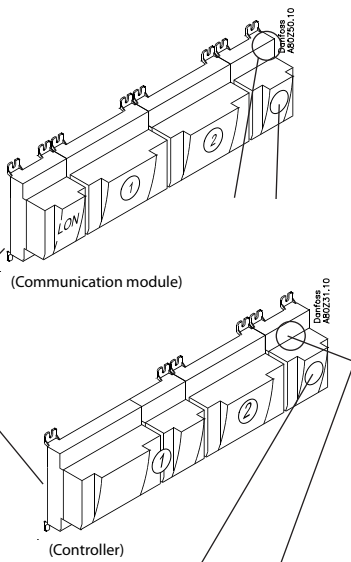

Signal	Active at	Module	Point	Terminals
			1 (DI 1)	1 - 2
			2 (DI 2)	3 - 4
			3 (DI 3)	5 - 6
			4 (DI 4)	7 - 8
			5 (DI 5)	9 - 10
			6 (DI 6)	11 - 12
			7 (DI 7)	13 - 14
			8 (DI 8)	15 - 16